


## ECLIPSE NO. 2000-B BLOW-OFF HYDRANT

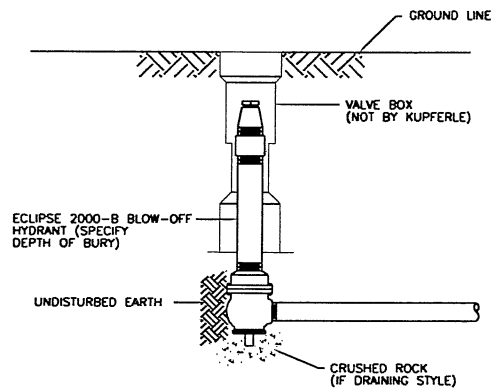

Blow-off Hydrants shall be No. 2000-B as manufactured by the John C. Kupferle Foundry Co., St. Louis, Mo.

Hydrants shall be compression type closing with the pressure and furnished with a 2" FIP inlet. Water pressure alone shall close the valve. Hydrants shall be operated by use of a portable top stock coupling with the hydrant at or near the ground line.

Hydrants shall be arranged for \_\_\_\_\_ depth of bury. Working parts, thread protector and operating rod shall be brass and removable from the hydrant without the need for excavation. Brass thread protector shall have a 2" square nut.

Hydrants shall be installed underground in a (specify a meter box or 5'-1/4" adjustable valve box)

(Please specify hydrants to be draining or non-draining)

# WATER STANDARD DETAIL

SNOQUALMIE PASS  
UTILITY DISTRICT

FILE	SCALE	DATE
SPUDTW5	NTS	07/28/04