


**PLAN**

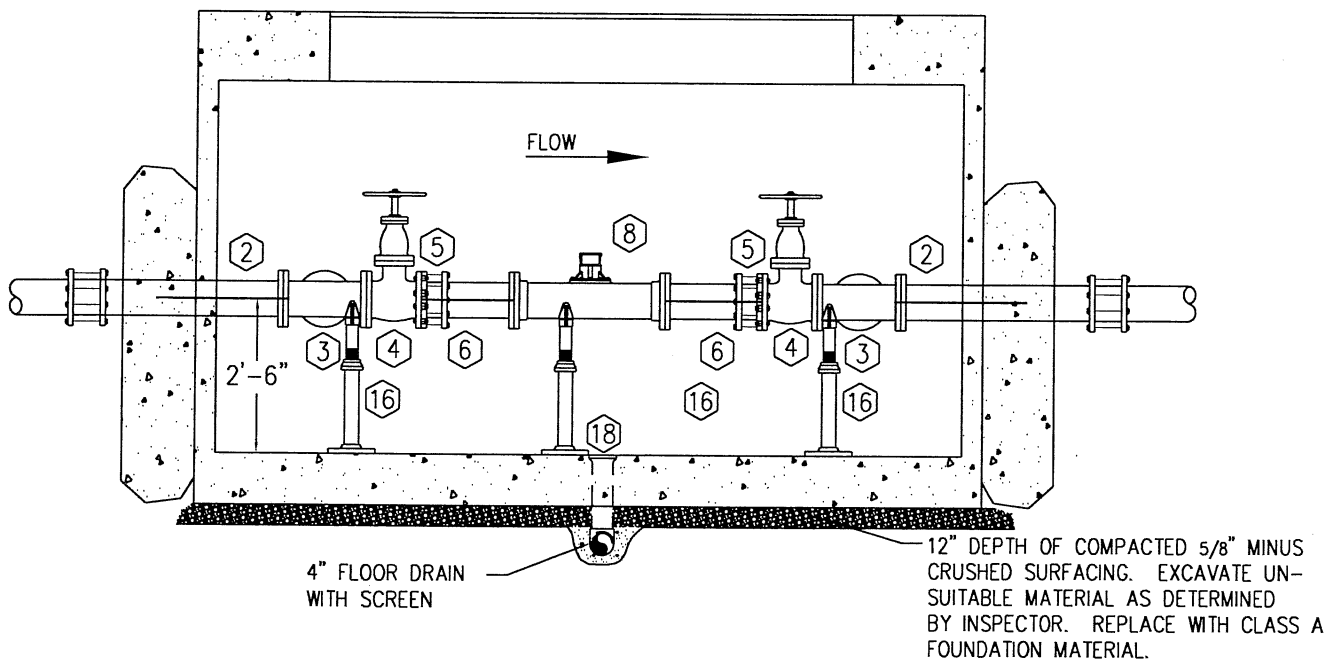

**ELEVATION**

**2", 3", 4" AND 6" COMPOUND METER SERVICE**

**WATER STANDARD DETAIL**

**SNOQUALMIE PASS  
UTILITY DISTRICT**

FILE	SCALE	DATE
SPUDTW27	NTS	7/22/04

## MATERIAL LIST

ITEM    DESCRIPTION

- ① LONG BODY SLEEVE
- ② DI SPOOL (FLxPE), 3'-0" LONG
- ③ DI TEE (FLxFLxFL) WITH BLIND FLANGE WITH 2" IPT TAP
- ④ RESILIENT SEAT GATE VALVE (FLxFL) WITH HAND WHEEL
- ⑤ FCA
- ⑥ 6" DI SPOOL (FLxPE), 1'-7" LONG  
4" DI SPOOL (FLxPE), 2'-2" LONG  
3" DI SPOOL (FLxPE), 2'-8" LONG  
NOT USED
- ⑦
- ⑧ METER (FLxFL), DISTRICT TO PROVIDE
- ⑨ CONCRETE THRUST RESTRAINT WITH TIE RODS PER DISTRICT STANDARDS

ITEM    DESCRIPTION

- ⑩ 2" THREADED BRASS NIPPLES (3" LONG)
- ⑪ 2" BALL VALVE WITH PADLOCK WINGS AND THREADED ENDS
- ⑫ 2" BRASS ST ELL
- ⑬ 2" THREADED BRASS PIPE, LENGTH TO FIT
- ⑭ 2" BRASS FLANGE METER COUPLINGS
- ⑮ 2" METER, DISTRICT TO PROVIDE
- ⑯ ADJUSTABLE PIPE SUPPORT EQUAL TO STANDON #S92
- ⑰ FREE STANDING GALVANIZED STEEL LADDER, ATTACH TO FLOOR AND SIDE OF HATCH.
- ⑱ 4" FLOOR DRAIN W/ SCREEN
- ⑲ 4" SCHEDULE 40 PVC PIPE

### PAINTING SCHEDULE

**CONCRETE EXTERIORS BELOW GRADE**

SURFACE SHALL BE CLEAN AND DRY. PAINT WITH TWO COATS OF TNEMEC PRIMER SERIES 46-465 COAL TAR SOLUTION (OR EQUAL) 8.0 TO 10.0 MILS DFT.

**CONCRETE INTERIORS**

WALLS AND CEILINGS - TWO (2) COATS OF ICI DEVOE 4308-1000 WHITE  
FLOORS - NONE.

**METAL (EXCEPT FACTORY FINISH PAINTED EQUIPMENT)**

ONE (1) SHOP COAT OF ICI DEVOE RUST BLOCK, 4100-7100 RED METAL PRIMER  
TWO (2) COATS ICI DEVOE GROTTO BLUE D-104

## 2", 3", 4" AND 6" COMPOUND METER SERVICE NOTES

# WATER STANDARD DETAIL

**SNOQUALMIE PASS  
UTILITY DISTRICT**

FILE	SCALE	DATE
SPUDTW27	NTS	7/22/04